


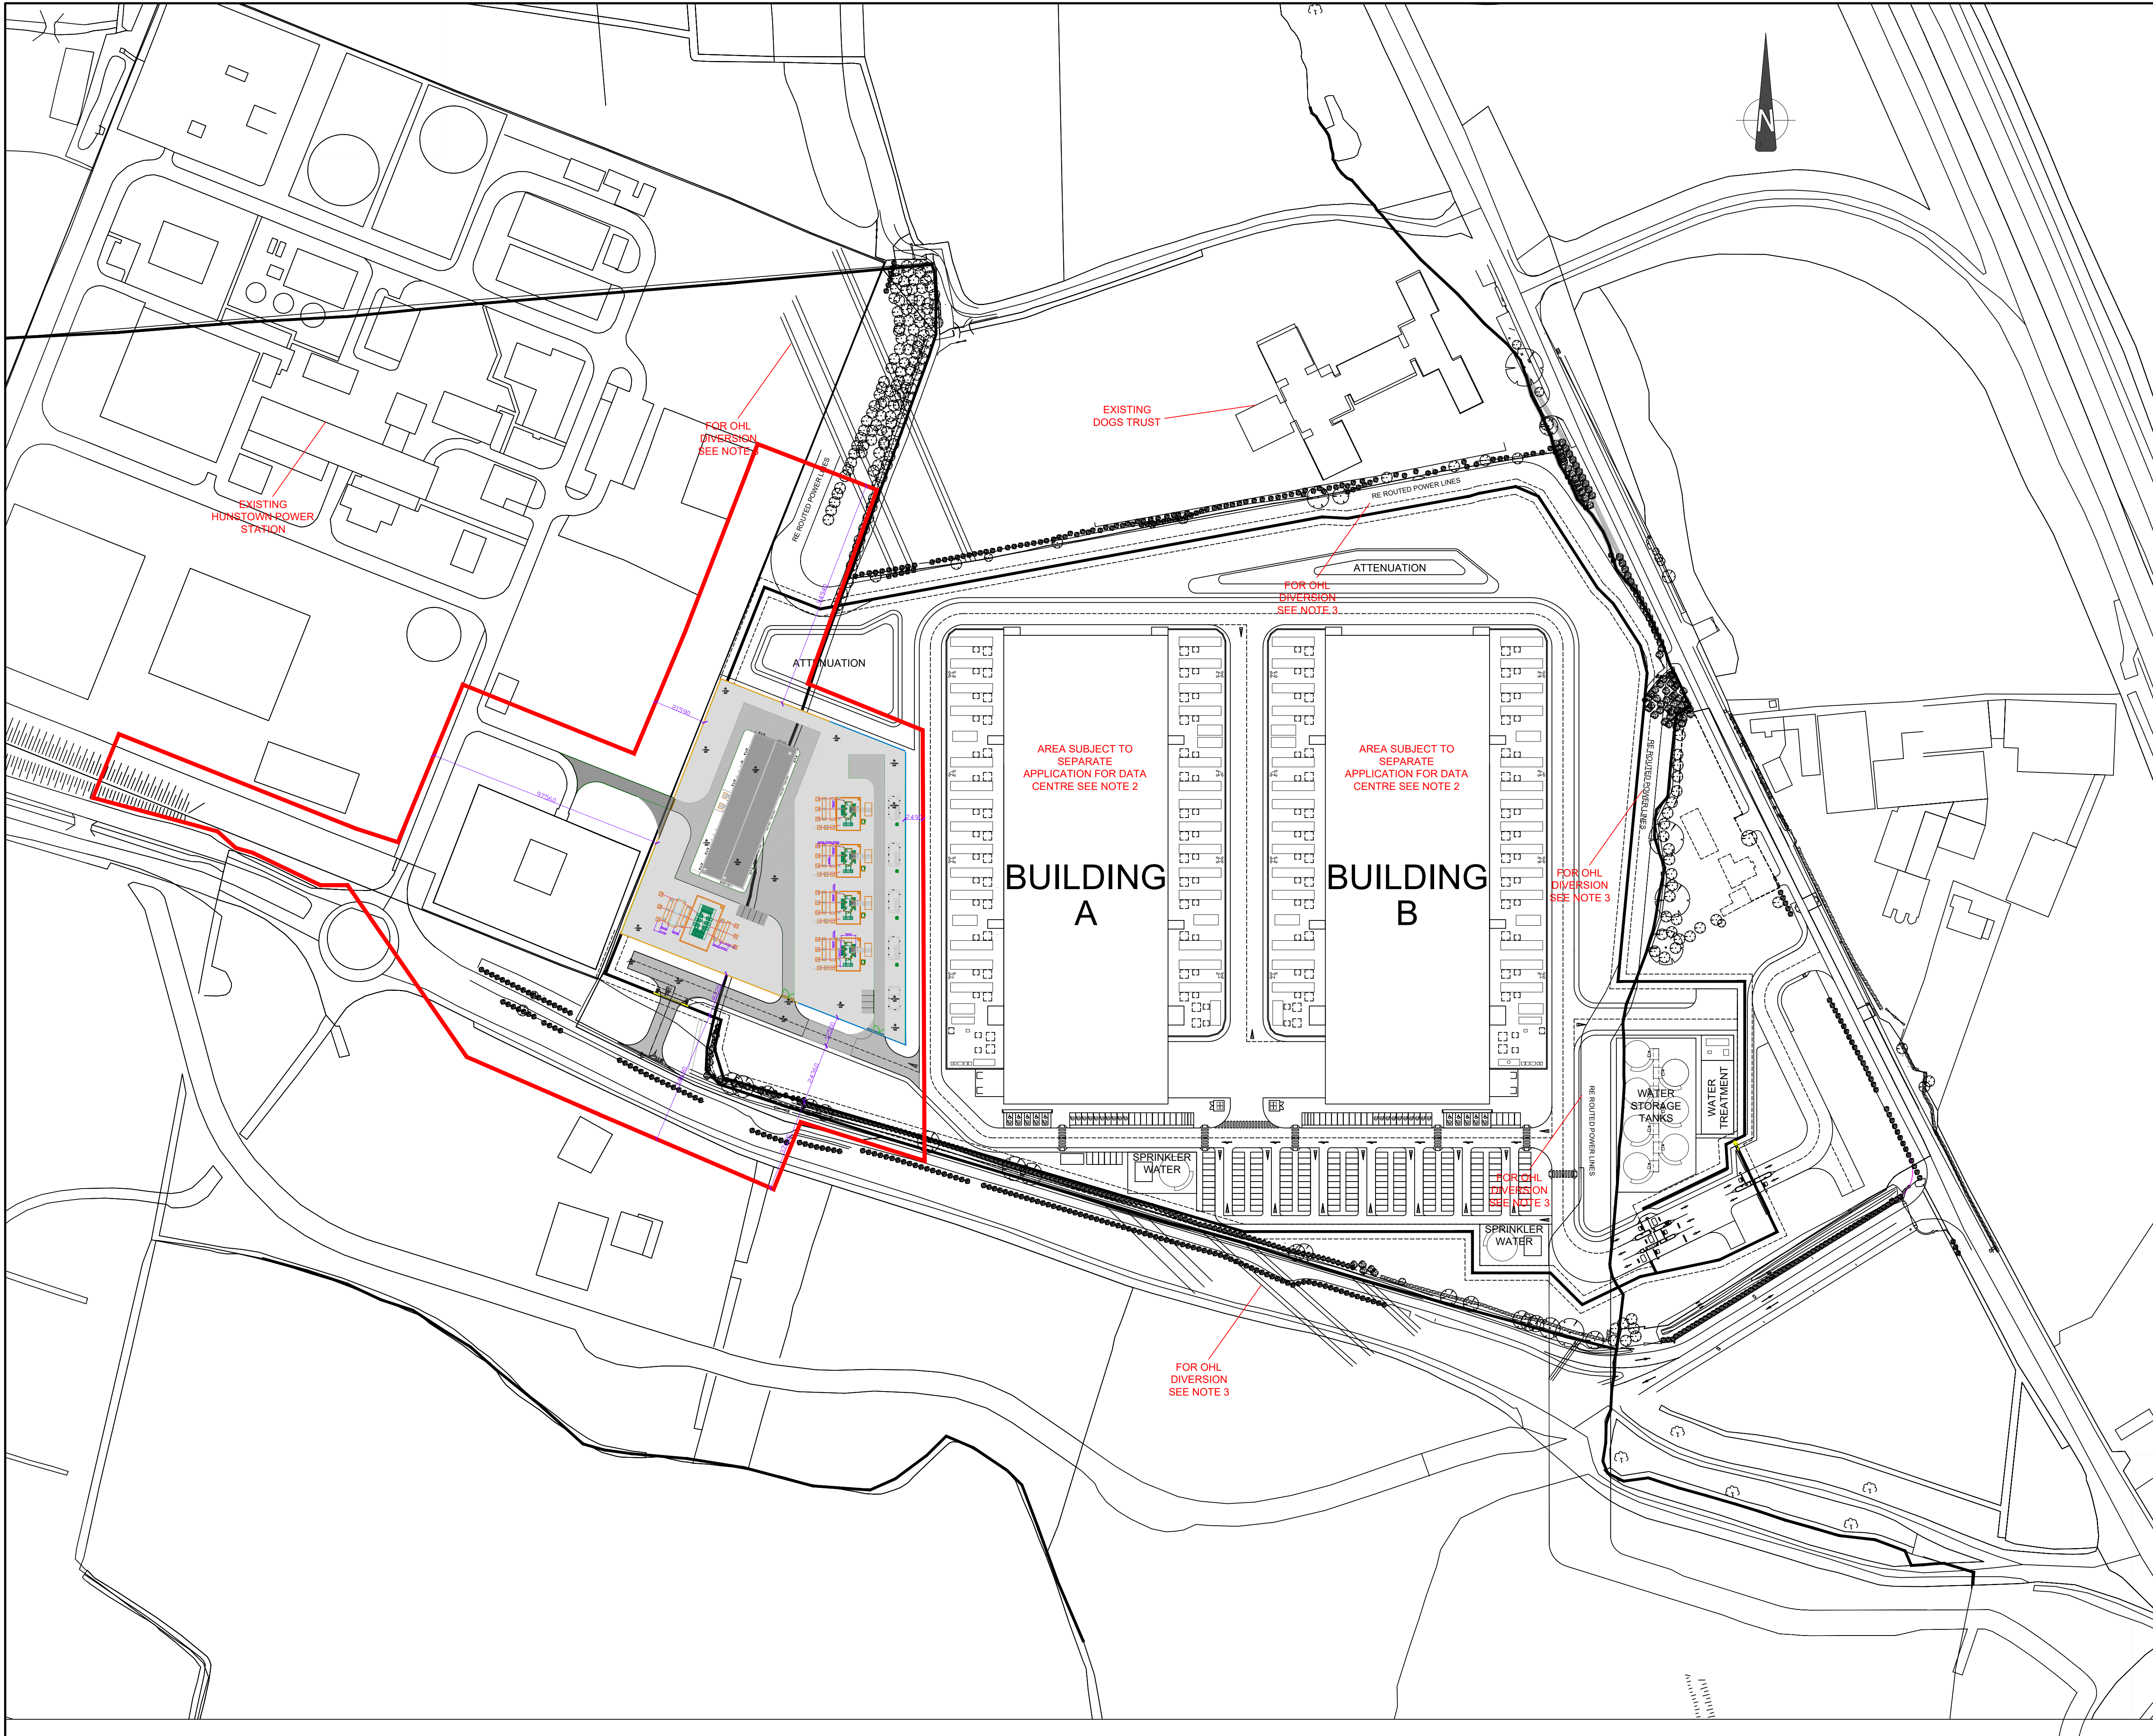

AECOM

PROJECT

PROJECT CIRRUS

CLIENT

HUNTSTOWN POWER
COMPANY LTD.

energía

CONSULTANT

AECOM
Adelphi Plaza
Georges Street Upper
Dun Laoghaire
County Dublin
Ireland
T +353 (0)1 2383100
www.aecom.com

LEGEND

PROPOSED DEVELOPMENT
BOUNDARY ASSOCIATED TO
THIS PLANNING APPLICATION

NOTES

1. DRAWINGS ARE INDICATIVE ONLY AND SHOULD NOT BE USED FOR A DETAILED DESIGN;
2. FCC REFERENCE NUMBER TO DATA CENTRE APPLICATION IS FW21A/0151;
3. FCC REFERENCE NUMBER TO OHL APPLICATION IS FW21A/0144;
4. SCALE PROVIDED AT 1:1250 TO INCLUDE THE CONCURRENT APPLICATION SITE FOR CONTEXTUAL PURPOSES.

ISSUE/REVISION

ISSUE/REVISION	DATE	DESCRIPTION
P1	14/09/2021	FOR PLANNING
P0	10/09/2021	FOR PLANNING
I/R	DATE	DESCRIPTION

STATUS

FOR PLANNING

PROJECT NUMBER

60641561

SCALE

1:1250 @ A1

SHEET TITLE

MOORETOWN 220KV SUBSTATION
SITE MASTERPLAN

SHEET NUMBER

60641561-DWG-732

REV

P1

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.